

Rheology and friction loss of raw and digested sewage sludge with high TSS concentrations: a case study

K. Füreder, K. Svardal, J. Krampe, H. Kroiss

Institute for Water Quality and Resource Management, Technische Universität Wien,
Karlsplatz 13/226-1, 1040 Wien, Austria

E-mail: k.fuereeder@iwag.tuwien.ac.at

Abstract

High total suspended solids (TSS) digestion of municipal sewage sludge reduces the required space and volume for digestion plants. However, an important consequence of high TSS is the major influence on sludge rheology. The present case study investigates the rheology of sludge from a 130 m³ high solids digestion pilot plant at Vienna's main wastewater treatment plant (4 Mio. PE₁₂₀). Raw sludge ranged from 6 to 8% TSS and digested sludge from 3.2 to 4.6%. TSS show an exponential impact on rheological parameters. Increasing raw sludge TSS from 6 to 8% at least doubles the shear stress and increases friction loss by a factor of three. However, under real operating conditions simulated at the pilot plant, there are additional impact factors. The mixing ratio between waste activated and primary sludge influences raw sludge rheology, while solids retention time and loss on ignition affects digested sludge rheology. Nevertheless, friction loss calculations based on a simple power law relationship between shear rate and shear stress proved to be applicable and sufficiently accurate for both raw and digested sludge with high TSS. Altogether, this case study underlines the relevance of comprehensive rheological considerations, measurements and calculations when designing a high TSS sludge digestion.

Keywords

high-solid digestion; high TSS sludge rheology; non-Newtonian fluid dynamics; laminar and turbulent flow; head loss in sludge pipes; design considerations and practical application; rheological variability of sewage sludge

©IWA Publishing [2017]. The definitive peer-reviewed and edited version of this article is published in Water Science & Technology, Volume 2017, Bonus Issue 1, 276-286, 2017, <https://doi.org/10.2166/wst.2018.111> and is available at www.iwapublishing.com.

This is the accepted version.

ABBREVIATIONS

DS	digested sludge
LOI	loss on ignition (%)
MIF	electromagnetic flow meter
PE ₁₂₀	population equivalent; assuming 120 g COD PE ⁻¹ d ⁻¹
PS	primary sludge
RawS	raw sludge (= WAS + PS + thickening-polymer)
SRT	solids retention time (in digestion plant) (d)
TSS	total suspended solids (concentration) (%)
WAS	waste activated sludge
WWTP	wastewater treatment plant

NOMENCLATURE

D	pipe inside diameter (m)
f	fanning friction factor (-)
k	pipe wall roughness (-)
K	fluid consistency index (Pa.s ⁿ)
n	flow behavior index (-)
R	pipe inside radius (m)
Re_{MR}	Metzner and Reed Reynolds number (-)
$Re_{MR,krit}$	critical Metzner und Reed Reynolds number (-)
v	average velocity (m s ⁻¹)
$\dot{\gamma}$	shear rate (s ⁻¹)
ρ	fluid density (kg m ⁻³)
τ	shear stress (Pa)
τ_y	yield stress (Pa)
τ_w	wall shear stress (Pa)

INTRODUCTION

Anaerobic digestion is a standard method for stabilizing sewage sludge at digested sludge TSS concentrations of approx. 2%. However, the global urbanization process is putting pressure on existing digester volumes resulting from increasing sludge loads (Eshtiaghi et al., 2013). To avoid the extension of existing digester volumes or to reduce digester volume and physical footprint of new plants, digesters can be operated at TSS concentrations higher than 2% (Kapp, 1984; Duan et al., 2012; Reichel, 2015). However, there are specific limiting factors: high solid concentrations in the feed lead to high $\text{NH}_4\text{-N}$ - and, depending on pH, also to high $\text{NH}_3\text{-N}$ -concentrations in the digested sludge, which can have an inhibiting effect on archaea methanogens. Reichel (2015) and Jahn et al. (2016) show that for a stable anaerobic degradation of organic compounds, $\text{NH}_4\text{-N}$ concentrations must not exceed $2,000 \text{ mg L}^{-1}$, corresponding to approx. $60 \text{ mg L}^{-1} \text{ NH}_3\text{-N}$ at pH 7.4 and $37 \text{ }^\circ\text{C}$, which is in line with investigations by Kroiss (1985). Another important consequence is the impact of high TSS on the rheological properties of sludge, affecting pumping, mixing, heat exchangers, pipe dimensioning, friction loss and subsequently energy requirements (Eshtiaghi et al., 2012; Ratkovich et al., 2013).

Vienna's main wastewater treatment plant (WWTP) is a 2-stage activated sludge plant with a capacity of 4 Mio. PE_{120} . Space requirements, minimization of digester volume and as a consequence costs are the driving forces for the construction of a high-TSS digestion plant, which is planned to be operational in 2020. In order to have a sound basis for design and operation a 130 m^3 pilot scale digester with approx. 4% TSS was operated for two years (Reichel, 2015). 4% TSS in digested sludge (DS) can be achieved by feeding the raw sludge (RawS) with 7 - 8% TSS. Regarding rheology, a major challenge in increasing the TSS is the exponential increase in shear stress and friction loss. Hence, the present case study investigates the impact of TSS on the rheological properties and friction loss of raw sludge with 6 to 8% TSS and digested sludge with 3.2 to 4.6% TSS. Both raw and digested sludge, sampled between April 2013 and June 2014, represent the rheological variability of sludge from Vienna's main WWTP when operated over a period of approx. one year. In contrast to waste activated sludge (WAS), hardly any data on the rheology of mixed raw sludge was found in literature. In order to allow the comparison with literature data, the present case study also examined WAS from 2 to 6% TSS. Furthermore, the case study investigated the practical applicability of non-Newtonian friction loss calculations based on a simple power law relationship between shear rate and shear stress. In addition, the flow regime (laminar/turbulent) of raw and digested sludge samples with high TSS was studied at different velocities and diameters with regard to the practical implementation of sludge pipelines.

In this paper, raw sludge is defined as a mixture of WAS and primary sludge (PS), with polymers added for thickening.

Impact of TSS on the rheological behavior of WAS and digested sludge

Sludge rheology has been subject to a wide variety of different analyses, compare Ratkovich et al. (2013) and Klinksieg (2010) for compact overviews. Numerous authors focused especially on the impact of TSS on the rheology of WAS and digested sludge. According to Ratkovich et al. (2013)

©IWA Publishing [2017]. The definitive peer-reviewed and edited version of this article is published in *Water Science & Technology*, Volume 2017, Bonus Issue 1, 276-286, 2017, <https://doi.org/10.2166/wst.2018.111> and is available at www.iwapublishing.com.

This is the accepted version.

only investigations with sufficient similarity to the experimental set up in this paper, regarding TSS, temperature and measurement process, were taken into account. In addition, only shear stresses determined at a shear rate of 500 s^{-1} were considered, being the maximum shear rate of the rheological measurements carried out in the present study.

The TSS/shear stress relationship in all qualified papers (Bau, 1986; Günder, 1999; Mori et al., 2006; Rosenberger et al., 2002; Baudez et al., 2011; Slatter, 1997; Moshage, 2004) can be either modeled as exponential law ($\tau = a \cdot e^{b \cdot \text{TSS}}$; $R^2 > 0.96$) or as power function ($\tau = a \cdot \text{TSS}^b$; $R^2 > 0.96$). Exponential models tend to over-estimate, while power functions tend to underestimate shear stress at high TSS concentrations. Overall, exponential modeling gave the best results (Figure 1a). The TSS-shear stress relationship of all data points taken together for WAS and digested sludge can be approximated with an exponential law as well (Figure 1b). In accordance with Hellmann and Riegler (2003) it shows that the shear stress of WAS rises much faster than the shear stress of digested sludge.

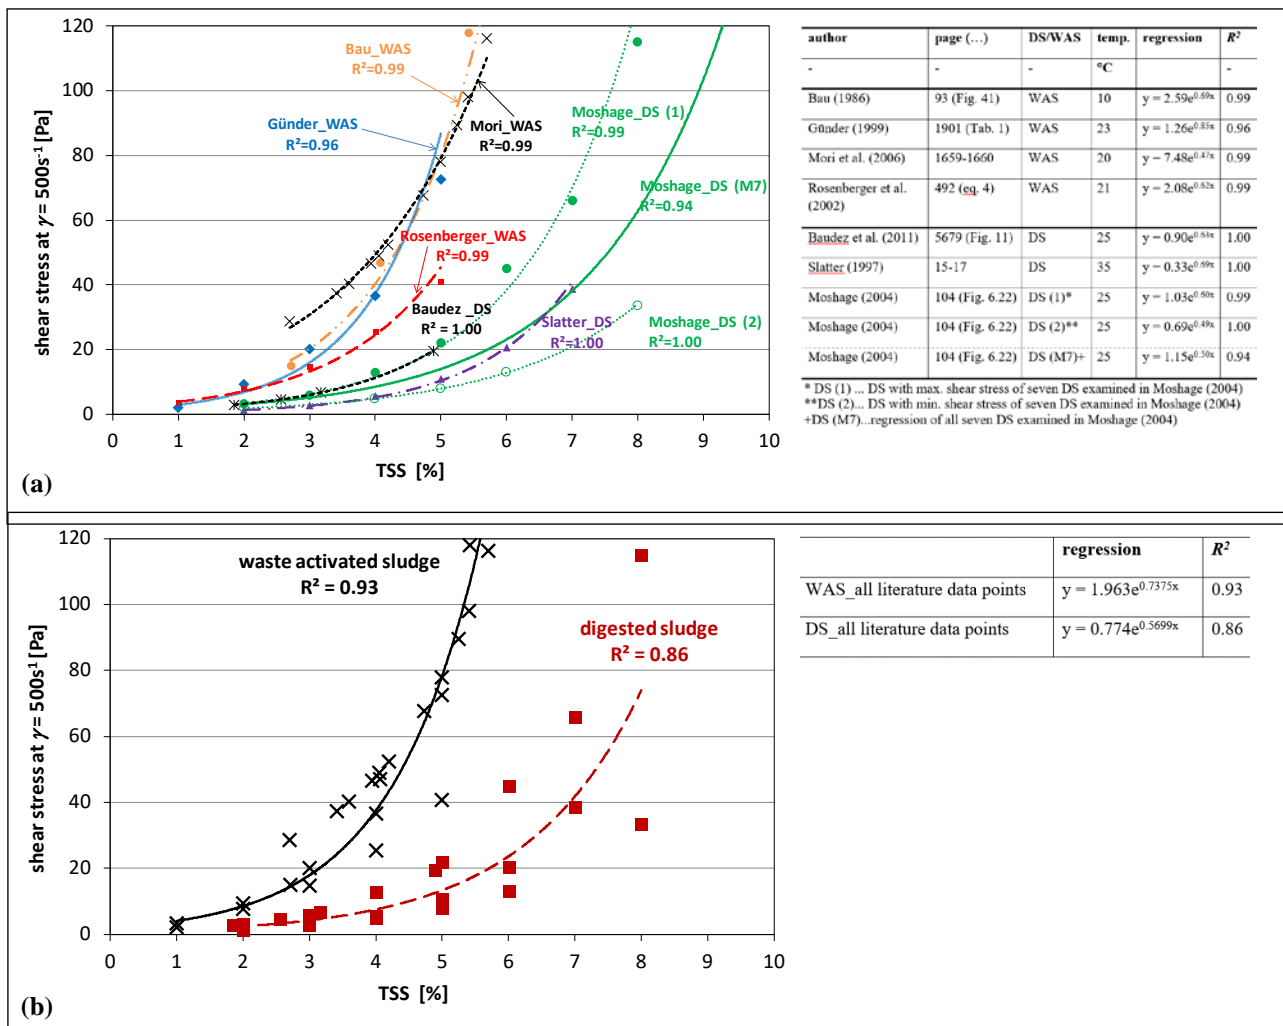


Figure 1. Literature review on the correlation of TSS and shear stress at $\dot{\gamma} = 500 \text{ s}^{-1}$ – exponential modeling: (a) evaluation of individual literature, (b) evaluation of all literature data points together

Friction loss calculations

©IWA Publishing [2017]. The definitive peer-reviewed and edited version of this article is published in Water Science & Technology, Volume 2017, Bonus Issue 1, 276-286, 2017, <https://doi.org/10.2166/wst.2018.111> and is available at www.iwapublishing.com.

This is the accepted version.

Friction loss calculations of non-Newtonian liquids such as sludge are based on the relationship between shear rate $\dot{\gamma}$ and shear stress τ , which is obtained by means of rheological measurements. Sludge with high TSS is a pseudoplastic fluid exhibiting a yield stress (τ_y). Slatter (2004, 2008), Swamee and Aggarwal (2011), Founargiotakis et al. (2008) and Haldenwang et al. (2012) showed complex implicit or explicit solutions based on the Herschel-Bulkley model ($\tau = \tau_y + K \cdot \dot{\gamma}^n$). Nevertheless – as to be shown in this paper – for practical applications also a simple power law model can be used:

$$\tau = K \cdot \dot{\gamma}^n \quad (1)$$

where K is the fluid consistency index and n is the flow behavior index. For laminar flow, the fanning friction factor f is obtained by Equation 2:

$$f = \frac{2 \cdot \tau_w}{\rho \cdot v^2} \quad (2)$$

where the wall shear stress τ_w can be calculated according to Böhme (2000) and Chhabra & Richardson (2008):

$$\tau_w = K \cdot \left[\frac{Q}{\pi R^3} \left(\frac{3n+1}{n} \right) \right]^n \quad (3)$$

In contrast to Herschel-Bulkley based equations applied in Slatter (2004, 2008), friction loss equations based on a simple power law relationship between shear rate and shear stress are independent of pipe wall roughness k , both for laminar and turbulent flow (Annen, 1961; Chhabra and Richardson, 2008). For turbulent flow the fanning friction factor f is obtained according to Dodge & Metzner (1959):

$$\frac{1}{\sqrt{f}} = \left(\frac{4}{n^{0.75}} \right) \cdot \log \left(Re_{MR} \cdot f^{1-\frac{n}{2}} \right) - \frac{0,4}{n^{1.2}} \quad (4)$$

where the Metzner and Reed Reynolds Number Re_{MR} is calculated according to Metzner & Reed (1955):

$$Re_{MR} = \frac{v^{2-n} \cdot D^n \cdot \rho}{8^{n-1} \cdot K \cdot \left(\frac{3n+1}{4n} \right)^n} \quad (5)$$

Re_{MR} depends on the average velocity v , pipe diameter D and the rheological properties of the sludge. It shows a positive correlation with v and D ; and a negative correlation with TSS. As sludge becomes progressively more fluid with increasing temperature (Baudez et al., 2013), Re_{MR} also shows a positive correlation with temperature. In analogy to Newtonian liquids, the flow regime of sludge depends on the magnitude of Re_{MR} . For Chhabra & Richardson (2008) an acceptable approximation of $Re_{MR,krit}$ is 2,000 - 2,500.

©IWA Publishing [2017]. The definitive peer-reviewed and edited version of this article is published in Water Science & Technology, Volume 2017, Bonus Issue 1, 276-286, 2017, <https://doi.org/10.2166/wst.2018.111> and is available at www.iwapublishing.com.

This is the accepted version.

MATERIALS AND METHODS

Sludge samples

The samples of WAS were obtained from the first stage of Vienna's main WWTP, where the sludge age is 1.5 - 2d. To remove larger particles, the samples were sieved (1.5 x 20 mm). The removed fraction was <0.25 wt%. For reasons of homogenization, samples were briefly shaken (by hand; for 3 seconds) directly prior to filling the measuring system. WAS samples with different TSS were derived from one single sludge sample in order to exclude other impact factors than TSS. The initial TSS of 1.8% was concentrated to higher TSS by using a centrifuge (Sigma 3-16L; 4,200 rpm; 3-5 min). A total of 10 WAS samples with TSS ranging from 1.8 - 6.2% was measured. The experiments were conducted at temperatures of both 8°C and 20°C, representing the minimum and maximum water temperatures in the activated sludge tank. TSS concentrations of the measurement series at 8°C (1.8 / 2.7 / 3.6 / 5.4 / 6.0%) deviate slightly from TSS concentrations at 20°C (1.9 / 2.9 / 3.9 / 4.8 / 6.2%).

In contrast to WAS samples, that only vary in TSS, the properties of raw and digested sludge samples represent the rheological variability of sludge from Vienna's main WWTP treatment plant when operated over a period of approx. one year. Raw sludge, a mixture of WAS and PS plus polymer addition for thickening, was sampled in the outlet of a pilot scale excess sludge thickener between April 2013 and June 2014. In front of the mechanical excess sludge thickening, WAS and PS were settled together in the existing static thickener of Vienna's main WWTP. The mixing ratio WAS/PS of raw sludge was estimated based on the incoming TSS-loads of WAS and PS to the static thickener. On a yearly average, the mixing ratio WAS/PS of the raw sludge was 50/50. However, due to different weather conditions and operational reasons, the percentage of PS ranged from 40 to 60%. The polymer used (ACAT: FlocStar 214L) is a cationic flocculant with a very high charge and a high molecular weight (active substance: ethoxylated isotridecanol). The dosage of polymer added at the excess sludge thickener was varied between 1 and 4 kg active substance/t TSS. To remove larger impurities raw sludge samples were sieved (1.5 x 20 mm) and the removed fraction was <0.5 wt%. For reasons of homogenization, samples were briefly shaken directly prior to filling into the measuring system. Furthermore, time delay between sampling and measurement had to be carefully controlled since exceeding a delay of 6 hours led to relevant changes in the structure of the polymer and thus to an underestimation of the actual viscosity and the shear stress of raw sludge. Therefore, the delay due to transport, sample preparation and measuring procedure was kept between 3 to 6 hours. The experiments were conducted at temperatures between 8°C and 40°C in order to get information about the impact of temperature on shear stress and friction loss of raw sludge. A total of 21 raw sludge samples with TSS ranging from 6.0 - 8.1% was measured. However, as the pilot scale plant was fed with a raw sludge TSS of about 7 to 8% most of the time, most of the raw sludge samples show a TSS between 7 and 8% (n=15) and fewer samples show a TSS between 6 to 7% (n=6).

Digested sludge was sampled at the outlet of a 130 m³ high TSS pilot plant digester located on the treatment plant. The treatment before filling the measuring system (sieving, shaking) was similar

©IWA Publishing [2017]. The definitive peer-reviewed and edited version of this article is published in *Water Science & Technology*, Volume 2017, Bonus Issue 1, 276-286, 2017, <https://doi.org/10.2166/wst.2018.111> and is available at www.iwapublishing.com.

This is the accepted version.

to the treatment of WAS samples. For digested sludge, all experiments were conducted at 38°C, representing the typical temperature for anaerobic digestion. A total of 9 digested sludge samples with TSS ranging from 3.2 - 4.6% was measured between April 2013 and June 2014. The first 5 digested sludge samples were investigated at a solids retention time (SRT) of 25 d, while the remaining 4 samples were investigated at a SRT of 20d.

Rheological measurements

The friction loss calculation of sludge is based on flow curves (= the relationship between shear rate $\dot{\gamma}$ and shear stress τ) which are obtained by means of rheological measurements. The measurements were carried out with an Anton Paar Physica MCR 301 rheometer equipped with concentric cylinder geometry CC39 (measuring gap 1.638 mm, Searle system). For temperature control the tempering cylinder C-LTD180/XL was used. Based on the experiments of Moshage (2004), the procedure was conducted as follows: within a period of 180 s the shear rate was increased to a maximum of 500 s⁻¹, held constant for 300 s, and finally was decreased to 0 s⁻¹ within a period of 180 s. The upward ramp of the flow curve represents unstressed sludge and is used for further calculations. Each upward ramp consist of 180 shear rate/shear stress data points. At a number of three replicates and under repeatability conditions as defined in DIN ISO 5725-1 (1994), the mean value of the relative standard deviation of all 180 data points was < 2% for WAS and digested sludge and < 5% for raw sludge. The maximum values of the relative standard deviation, which in most cases occur at low shear rates, came to < 5% for WAS and digested sludge and to < 10% for raw sludge. The number of replicates per measurement was set to two for WAS and digested sludge and to three for raw sludge. Power-law modeling was carried out with the mean values of the replicates.

Differential pressure measurements

For the validation of the friction loss calculations based on rheological measurements, differential pressure measurements at a rheological test track were carried out (Figure 2).

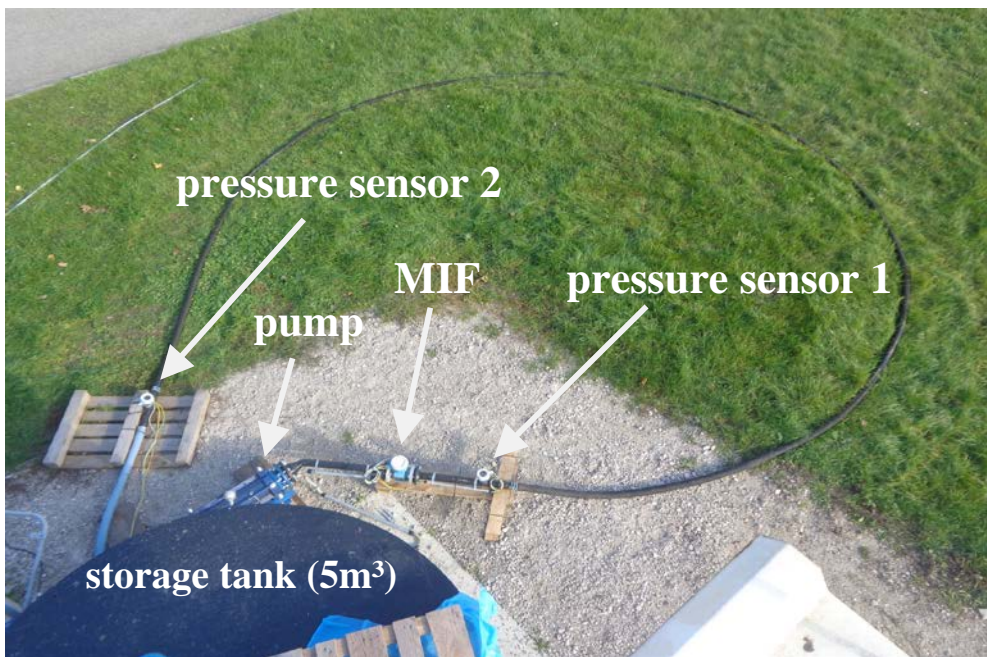


Figure 2. Rheological test track – pressure hose $D = 50$ mm, 2 pressure sensors, electromagnetic flow meter (MIF), eccentric pump, storage tank 5 m^3

The test track was a circular pressure hose (TORONTO HED; $L = 40$ m; $D = 50$ mm; material: styrene-butadiene rubber (SBR) with fabric inserts and steel wire helix, smooth wall; <http://www.bebeflex.at/toronto.htm>). The friction loss was determined with pressure sensors at the beginning and end of the test track. For pumping an eccentric pump with a maximum flow rate of $16 \text{ m}^3 \text{ h}^{-1}$ was used. The volume of the storage tank for the sludge was 5 m^3 . Each flow rate (resp. velocity) was set for 2 to 5 minutes, carrying out pressure and flow rate measurements each 6 seconds. Hence, the number of measurement replicates was between 12 and 30 for each velocity. The relative standard deviation ranged between 1 and 3% for the flow rate and between 1 and 5% for the differential pressure. The mean values of the measurement data were used for the validation of friction loss calculations. The validation process was fraught with the following uncertainties:

- i. 0.5 L sample out of a 5 m^3 storage tank
- ii. time delay sampling/measuring \rightarrow structural change of polymer (only for raw sludge)
- iii. sample is sieved; and then shaken directly before measurement
- iv. deviations due to using a simple power law shear stress/shear rate model
- v. deviations due to shear stress peak of the flow curves (only for raw sludge, see Figure 3a)
- vi. circuit test track instead of straight test track
- vii. deviations in diameter of test track: ± 1 mm

Due to these uncertainties, it is an important additional aspect whether the rheological measurements are validated on a rheological test track.

RESULTS AND DISCUSSION

Power law modeling

The relevant parameters (K , n) for friction loss calculations are to be gained from the shear stress/shear rate relationship of the upward ramp of flow curves. In Figure 3 power law modeling of the upward ramp of a raw sludge sample with 7.2% TSS (a) and a digested sludge sample with 3.9% TSS (b) is compared to Herschel-Bulkley modeling. Since the upward ramps of raw sludge show a characteristic peak shear stress at low shear rates the models were not evaluated below a shear rate of 100 s^{-1} (Figure 3a), whereas for digested sludge they could be evaluated over the entire range of $0 - 500 \text{ s}^{-1}$ (Figure 3b). Both Herschel-Bulkley and power law modeling show good results. However, Herschel-Bulkley modeling ($R^2 > 0.999$) shows a slightly better correlation than power law modeling ($R^2 > 0.99$) for both raw and digested sludge. This can be explained by the yield stress behavior ($\rightarrow \tau_y$) of sewage sludge.

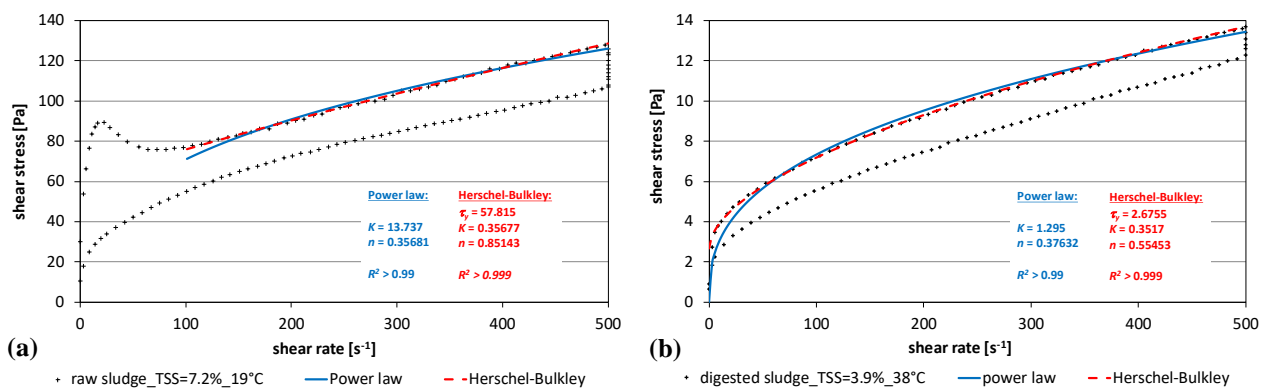


Figure 3. Power law modeling compared to Herschel-Bulkley modeling – (a) raw sludge (TSS = 7.2%; T = 19°C) and (b) digested sludge (TSS = 3.9%; T = 38°C)

Compared to sludge with 1 - 2% TSS, the rheological properties of sludge with high TSS significantly differ from water. Depending on the shear rate (500 s^{-1} to 0 s^{-1}), the shear stress – as well as the dynamic viscosity – of raw sludge with 7.2% TSS is approximately 200 to 10,000 times higher than water. The shear stress and the dynamic viscosity of digested sludge with 3.9% TSS is approximately 40 to 1,500 times higher than water, which has a major impact on friction loss, pipe dimensioning and pumping.

Friction loss calculation: Validation of power-law modeling

Friction loss calculation based on a power law relationship between shear rate and shear stress according to Equations 1 to 5 was validated by differential pressure measurements at the rheological test track. For comparison, friction loss calculations based on the more complex Herschel-Bulkley model were also accomplished. For the validation, the same modeling-approach was applied to 21 different “physical states” of sewage sludge, differing in sludge type, TSS, temperature and velocity (Figure 4). Both power law modeling ($R^2 = 0.99$) and Herschel-Bulkley modeling ($R^2 = 0.97$) show high coefficients of determination. However, power law modeling ($k = 0.96$) tends to underestimate,

©IWA Publishing [2017]. The definitive peer-reviewed and edited version of this article is published in Water Science & Technology, Volume 2017, Bonus Issue 1, 276-286, 2017, <https://doi.org/10.2166/wst.2018.111> and is available at www.iwapublishing.com.

This is the accepted version.

while Herschel-Bulkley modeling ($k = 1.06$) tends to overestimate the friction loss measured at the rheological test track (Figure 4). Nevertheless, considering the inherent uncertainties of the validation process (see above), the results proved the applicability of power law modeling for friction loss calculations regarding design purposes of high TSS sludge digestion.

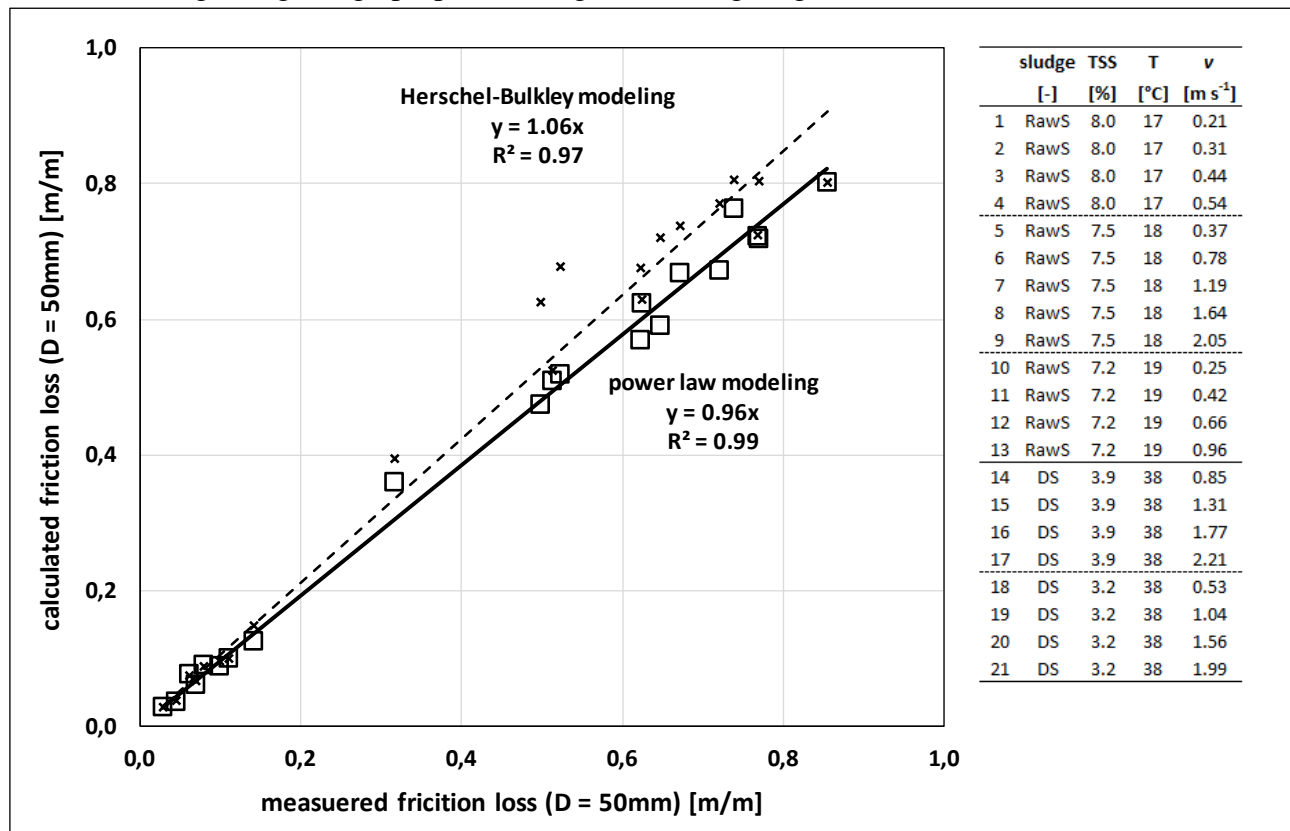


Figure 4. Validation of power law modeling (□) and Herschel-Bulkley modeling (×) by differential pressure measurements at the rheologic test track – 21 data points differing in sludge type (RawS / DS), TSS (8.0% / 7.5% / 7.2% / 3.9% / 3.2%), temperature (17°C / 18°C / 19°C / 38°C) and velocity (0.21 – 2.21 m s⁻¹); Herschel-Bulkley modeling according to Slatter (2008)

Shear stress and friction loss of WAS and raw sludge with high TSS

According to literature (data in Fig. 1) the relationship between TSS and shear stress could be approximated with an exponential law for both WAS and raw sludge. WAS samples at 8° and 20°C were derived from one single sludge sample, where only TSS was varied. The data of this investigation show a high correlation coefficient ($R^2 > 0.99$) as reported in literature. In contrast to that, raw sludge measurements were conducted with different sludge samples taken over a period of approx. one year, representing the variability of real operating conditions encountered in the full-scale plant. This resulted in a markedly lower correlation ($R^2 \geq 0.80$) and also a high shear stress variability was determined for samples with similar TSS (Figure 5a). This can mainly be attributed to the variable mixing ratio WAS/PS of raw sludge. Following relationship could be identified: The higher the share of PS, the lower the shear stress. This is exemplified in Figure 5a for two raw sludge samples with 8% TSS and a temperature of 30-40°C that only differ in the percentage share of PS. At a PS share of approx. 60% the shear stress is 80 Pa, at a PS share of approx. 40% the shear stress is

©IWA Publishing [2017]. The definitive peer-reviewed and edited version of this article is published in Water Science & Technology, Volume 2017, Bonus Issue 1, 276-286, 2017, <https://doi.org/10.2166/wst.2018.111> and is available at www.iwapublishing.com.

This is the accepted version.

115 Pa. This is in accordance with Markis et al. (2013), who showed that the viscosity and consequently, the shear stress of raw sludge decreases by a factor of 5 when increasing the share of PS from 20 to 80%. Furthermore, PS has a very heterogeneous nature (Bhattacharya, 1981). This is likely to be an additional impact factor regarding the rheological variability of different raw sludge samples with similar TSS. Nevertheless, TSS shows a major influence on the shear stress of raw sludge. On average, the shear stress of raw sludge with 8% TSS is about twice as high compared to 6% TSS (Figure 5a).

The influence of temperature on the shear stress of WAS and raw sludge is demonstrated, showing an inverse correlation (Figure 5a). The significantly lower shear stress of WAS compared to the assessed literature can be attributed to the low sludge age (1.5 - 2 d) of the measured WAS (Füreder, 2013). In the investigated WWTP the sludge age of 1.5 - 2 days corresponds to a very low development of filamentous bacteria and in a low sludge volume index $< 100 \text{ mL g}^{-1}$, respectively. As reported by Klinksieg (2010), a low sludge volume index corresponds to low shear stress.

In analogy to shear stress, TSS has a major influence on the friction loss of raw sludge. The friction loss of raw sludge with 8% TSS appears to be approximately two to three times higher than with 6% TSS (Figure 5b). This is shown exemplarily for a pipe with $D = 100 \text{ mm}$, $v = 1.5 \text{ m/s}$ and a raw sludge temperature of 16 - 20°C. Increasing the TSS from 6 to 8%, results in an increase of friction loss from 0.15 to 0.45 (Figure 5b). The TSS/friction loss correlation can be approximated by an exponential equation for all three temperature classes ($R^2 \geq 0.78$). The influence of temperature on friction loss is similar to its influence on shear stress. The variability of friction loss for samples with about the same TSS is also similar to the situation with shear stress (Figure 5b).

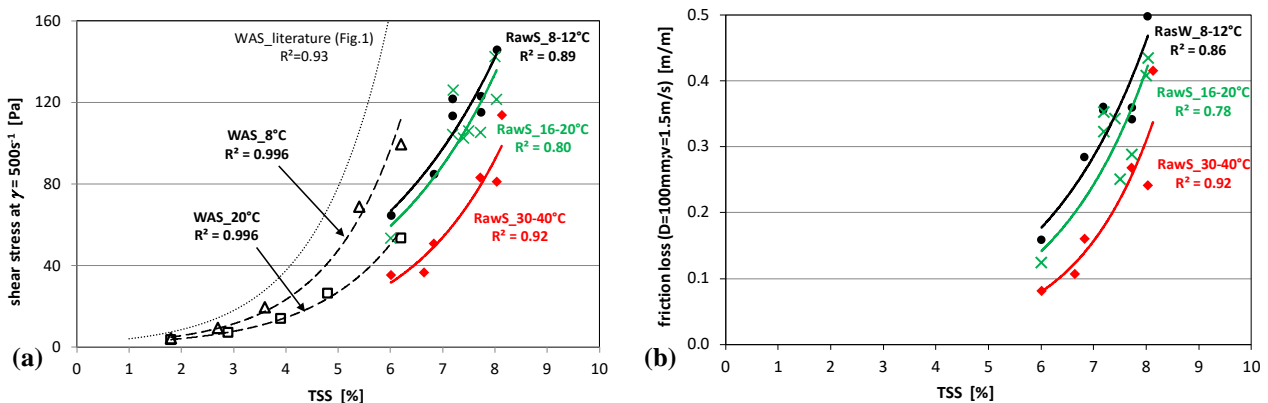


Figure 5. (a) TSS vs. shear stress of WAS and RawS at $\dot{\gamma} = 500 \text{ s}^{-1}$ (exponential modeling) (b) TSS vs. friction loss of RawS (exponential modeling)

Shear stress and friction loss of digested sludge with high TSS

Digested sludge samples were taken at the pilot plant over a period of approx. one year, representing real operating conditions. For the evaluation, the sludge samples were split into two data sets: samples

with SRT = 25 d and samples with SRT = 20 d. The shear stress of the samples is in the same order of magnitude as in literature. The relationship between TSS and shear stress could be approximated with an exponential law for both digested sludge data sets (Figure 6a). However, digested sludge samples with 20 d SRT show a higher shear stress and friction loss than samples with 25 d SRT (Figure 6a/b). This is consistent with Dai et al. (2014) and Monteiro (1997), who found out that shear stress of digested sludge stands in inverse correlation to SRT.

Furthermore, the impact of SRT overlaps with the impact of loss on ignition (LOI). Samples with approx. 62 to 66% LOI mostly show higher shear stress and friction loss than samples with approx. 58 and 62% LOI (Figure 6c/d), which is consistent with the research of Skinner et al. (2015), Moshage (2004) and Klinksieg (2010). Skinner et al. (2015) reported a strong negative correlation between LOI and dewaterability of digested sludge. So the higher LOI, the lower is dewaterability. In turn, Moshage (2004) and Klinksieg (2010) found out that low dewaterability of digested sludge strongly correlates with high shear stress. Based on these publications and the results shown in Figure 6c, it can be concluded that increased LOI of digested sludge correlates with an increase in shear stress.

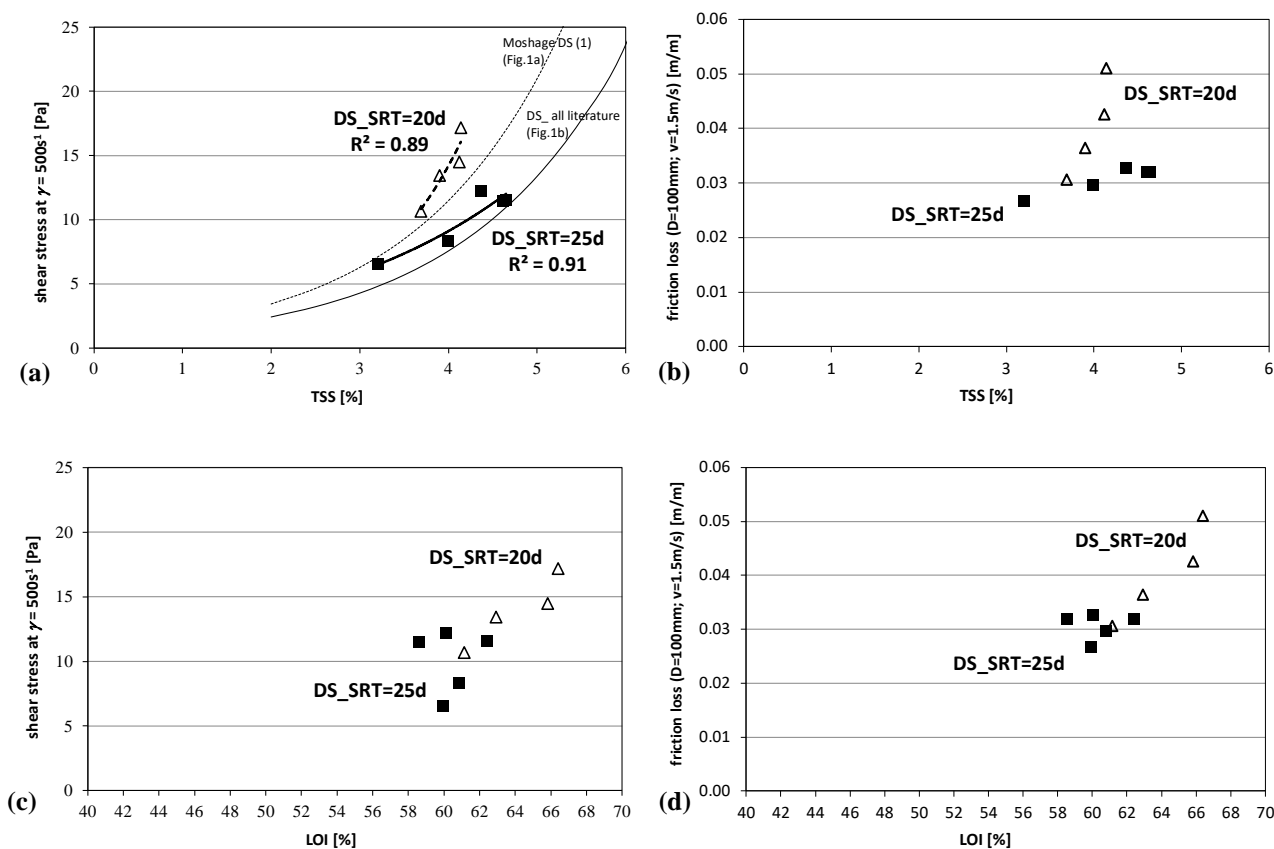


Figure 6. Digested sludge ($T = 38^{\circ}\text{C}$) with TSS ranging from 3.2 - 4.6% – (a) TSS vs. shear stress at $\dot{\gamma} = 500 \text{ s}^{-1}$ (b) TSS vs. friction loss (c) LOI vs. shear stress at $\dot{\gamma} = 500 \text{ s}^{-1}$ (d) LOI vs. friction loss

Flow regime of raw and digested sludge with high TSS

The flow regime of sewage sludge depends on Re_{MR} . Re_{MR} depends on pipe diameter D , average velocity v and the rheological properties of the sludge (K, n) (see equation 5). The higher v and D , the more likely is turbulent flow. Calculations for 13 different samples show that the flow regime of raw sludge with 7 - 8% remains laminar ($Re_{MR} < Re_{MR,krit}$) even at high average velocity of $v = 3 \text{ m s}^{-1}$ and a large pipe diameter of $D = 0.50 \text{ m}$ (Figure 7a).

Raw sludge with 7 - 8% TSS results in a digested sludge TSS of approx. 4%. For digested sludge with 4% TSS the flow regime can be either laminar ($Re_{MR} < Re_{MR,krit}$) or turbulent ($Re_{MR} > Re_{MR,krit}$). Depending on pipe diameter and sludge properties, a stable turbulent flow regime can only be reached at high velocities of 2 - 3 m/s (Figure 7b).

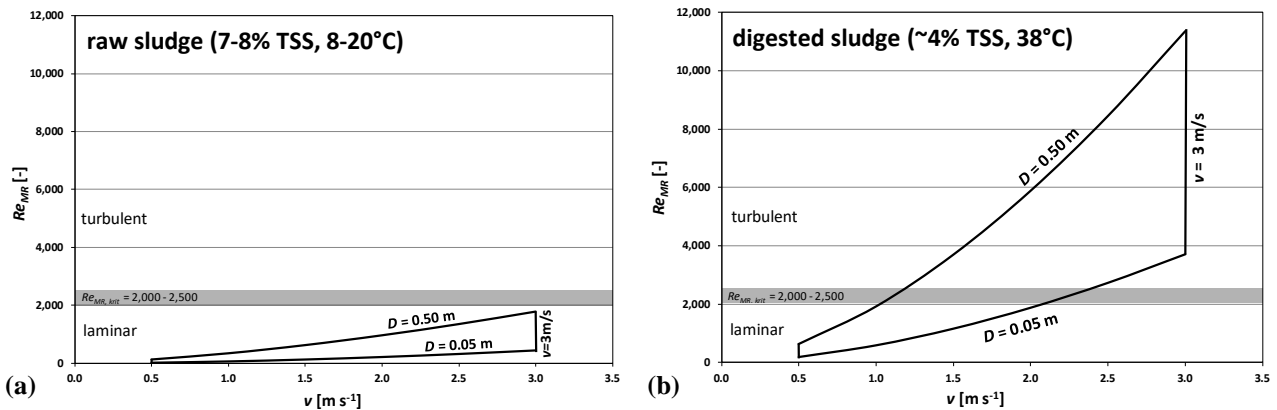


Figure 7. Re_{MR} as a function of v ($0.5 - 3.0 \text{ m s}^{-1}$) and D ($0.05 - 0.50 \text{ m}$) – (a) raw sludge: calculated with 13 different samples (TSS = 7 - 8%; T = 8 - 20°C), (b) digested sludge: calculated with 6 different samples (TSS = 3.8 - 4.6%; T = 38°C)

CONCLUSIONS

The current case study on the rheological behavior of raw and digested sewage sludge with high TSS concentrations was an indispensable part within the design of the 4 Mio PE₁₂₀ high TSS digestion plant under construction at Vienna's main WWTP operational in 2020. It emphasizes the importance of comprehensive rheological considerations, measurements and calculations when designing a sludge digestion with high TSS. In accordance with literature, TSS proved to have an exponential influence on the rheological behavior of raw sludge. Hence, increasing TSS from 6 to 8% at least doubles the shear stress of raw sludge, having major effects on pipe dimensioning and pumping. The correlation between TSS and friction loss could be approximated with an exponential function as well. However, under the real operating conditions simulated at the pilot plant, the impact of TSS on raw sludge rheology is overlapped by the impact of the mixing ratio WAS/PS. The higher the share of PS, the lower is the shear stress. For digested sludge, the exponential correlation between TSS and shear stress is overlapped by the influence of SRT and LOI. Digested sludge with 20 d SRT and approx. 64% LOI mostly showed higher shear stress and friction loss than digested sludge with 25 d SRT and approx. 60% LOI.

Within the case study, friction loss calculations based on a simple power law relationship between TSS and shear stress could be validated for raw and digested sludge with high TSS. For

friction loss calculations, the flow regime is of high importance. Raw sludge with 7 - 8% TSS has a strictly laminar behavior, even for a high average velocity of 3 m s^{-1} and a large pipe diameter of 0.5 m. Digested sludge with approx. 4% TSS showed either laminar or turbulent behavior depending on flow velocity and pipe diameter.

Flow regime and head loss predictions of digested sludge is a complex matter depending on many parameters changing over time, such as TSS, SRT, LOI and temperature. In this regard, the influence of SRT and LOI needs to be further elucidated. Regarding raw sludge rheology, the influence of the mixing ratio WAS/PS needs further investigations. Moreover, the impact of sludge age, extracellular polymeric substances and sludge thickening properties on the rheology of raw sludge needs to be investigated.

REFERENCES

- Annen, G. (1961). *Rohrströmung von Klärschlamm. Beitrag zur Hydraulik nichtnewtonscher Flüssigkeiten (Pipe flow of sewage sludge. Contribution to the hydraulics of non-newtonian liquids)*. Dissertation, Technische Hochschule Karlsruhe.
- Bau, K. (1986). *Rationeller Einsatz der aerob-thermophilen Stabilisierung durch Rohschlamm-Vorentwässerung (Efficient use of aerobic-thermophilic stabilization by means of raw sludge dewatering)*. Verein zur Förderung des Instituts für Wasserversorgung, Abwasserbeseitigung und Raumplanung der Technischen Hochschule Darmstadt.
- Bhattacharya, S.N. (1981). Flow characteristics of primary and digested sewage sludge. *Rheologica Acta* **20**, 288-298.
- Baudez, J.C., Markis, F., Eshtiaghi, N. & Slatter, P.T. (2011). The rheological behavior of anaerobic digested sludge. *Water Research* **45** (17), 5675-5680.
- Baudez, J.C., Slatter, P., Eshtiaghi, N. (2013). The impact of temperature on the rheological behaviour of anaerobic digested sludge. *Chemical Engineering Journal* **215–216**, 182-187.
- Böhme, G. (2000). *Strömungsmechanik nicht-newtonscher Fluide (Flow mechanics of non-Newtonian fluids)*. Teubner, Stuttgart.
- Chhabra, R.P., Richardson, J. F. (2008). *Non-Newtonian Flow and Applied Rheology: Engineering Applications*. Butterworth-Heinemann/Elsevier, Amsterdam.
- DIN ISO 5725-1 (1994). *Genauigkeit (Richtigkeit und Präzision) von Messverfahren und Messergebnissen – Teil 1: Allgemeine Grundlagen und Begriffe (Accuracy (trueness and precision) of measurement methods and results – Part 1: General principles and definitions)*.
- Dai, X., Gai, X., Dong, B. (2014). Rheology evolution of sludge through high-solid anaerobic digestion. *Bioresource Technology* **174**, 6-10.

©IWA Publishing [2017]. The definitive peer-reviewed and edited version of this article is published in *Water Science & Technology*, Volume 2017, Bonus Issue 1, 276-286, 2017, <https://doi.org/10.2166/wst.2018.111> and is available at www.iwapublishing.com.

This is the accepted version.

- Dodge, D.W. & Metzner, A.B. (1959). Turbulent Flow of Non-Newtonian Systems. *AICHE Journal* **5** (2), 189-204.
- Duan, N., Dong, B., Wu, B. & Dai, X. (2012). High-solid anaerobic digestion of sewage sludge under mesophilic conditions: feasibility study. *Bioresource Technology* **104**, 150-156.
- Eshtiaghi, N., Markis, F., Slatter, P.T. (2012). The laminar/turbulent transition in a sludge pipeline. *Water Science and Technology* **65** (4), 697-702
- Eshtiaghi, N., Markis, F., Yap S.D., Baudez, J. C., Slatter, P.T. (2013). Rheological characterisation of municipal sludge: A review. *Water Research* **47** (15), 5493-5510.
- Founargiotakis, K., Kelessidis, V.C., Maglione, R. (2008). Laminar, transitional and turbulent flow of Herschel–Bulkley fluids in concentric annulus. *Canadian Journal of Chemical Engineering* **86**, 676–683.
- Füreder, K. (2013). *Der Einfluss des Trockensubstanzgehalts auf die Fließfähigkeit von Überschuss-, und Faulschlamm der Hauptkläranlage Wien (The influence of TSS-content on the rheology of excess- and digested sludge of WWTP Vienna)*. Unpublished diploma thesis, Universität für Bodenkultur, Wien.
- Günder, B. (1999). *Rheologische Eigenschaften von belebten Schlämmen und deren Einfluss auf die Sauerstoffzufuhr (Rheological properties of waste activated sludge and their influence on oxygen supply)*. Korrespondenz Abwasser, Jahrgang 46 (12), 1896-1904.
- Haldenwang, R., Sutherland, A.P.N., Fester, V.G., Holm, R., Chhabra, R.P. (2012). Sludge pipe flow pressure drop prediction using composite power-law friction factor–Reynolds number correlations based on different non-Newtonian Reynolds numbers. *Water SA* **38** (4), 615-622.
- Hellmann, D. H. & Riegler, G. (2003). *Maschinentechnik in der Abwasserreinigung (Mechanical equipment in wastewater treatment)*. WILEY-VGH Verlag GmbH & Co. KGaA, Weinheim.
- Jahn, L., Baumgartner, T., Svoldal, K., Krampe, J. (2016). The influence of temperature and SRT on high-solid digestion of municipal sewage sludge. *Water Science and Technology* **74** (4), 836-843.
- Kapp, H. (1984). *Schlammfäulung mit hohem Feststoffgehalt (Sludge digestion at high solid content)*. Stuttgarter Berichte zur Siedlungswasserwirtschaft 86, Kommissionsverlag Oldenbourg, München.
- Klinksieg, K. (2010). *Charakterisierung des Absetzverhaltens von kommunalen Klärschlämmen mit Hilfe rheologischer Messungen (Characterization of the sedimentation behavior of municipal sewage sludge using rheological measurements)*. Gesellschaft zur Förderung des Instituts für Siedlungswasserwirtschaft an der Technischen Universität Braunschweig e.V.

©IWA Publishing [2017]. The definitive peer-reviewed and edited version of this article is published in *Water Science & Technology*, Volume 2017, Bonus Issue 1, 276-286, 2017, <https://doi.org/10.2166/wst.2018.111> and is available at www.iwapublishing.com.

This is the accepted version.

- Kroiss, H. (1985). *Anaerobe Abwasserreinigung (Anaerobic wastewater treatment)*. Wiener Mitteilungen, Band 62. Institut für Wassergüte und Landschaftswasserbau, Wien.
- Markis, F., Hii, K., Parthasarathy, R., Baudez, J., Slatter, P. and Eshtiaghi, N. (2013). 'Rheological characterization of blends of primary and secondary sludge', in Kathy Hirschfeld (ed.) *Chemeca 2013: Challenging Tomorrow*. Barton, ACT, Australia, 29 September - 2 October 2013, pp. 1-6.
- Metzner, A. B. & Reed, J.C. (1955). Flow of Non-Newtonian Fluids – Correlation of the Laminar, Transition, and Turbulent-Flow Regions. *AICHE Journal* **1** (4), 434-440.
- Monteiro, P.S. (1997). The influence of the anaerobic digestion process on the sewage sludges rheological behaviour. *Water Science Technology* **36** (11), 61–67.
- Mori, M., Seyssiecq, I. & Roche, N. (2006). Rheological measurements of sewage sludge for various solids concentrations and geometry. *Process Biochemistry* **41** (7), 1656-1662.
- Moshage, U. (2004). *Rheologie kommunaler Klärschlämme – Messmethoden und Praxisrelevanz (Rheology of municipal sewage sludge – measurement methods and practical relevance)*. Gesellschaft zur Förderung des Instituts für Siedlungswasserwirtschaft an der Technischen Universität Braunschweig e.V.
- Ratkovich, N., Horn, W., Helmus, F., Rosenberger, S., Naessens, W., Nopens, I. & Bentzen, T. (2013). Activated sludge rheology: A critical review on data collection and modelling. *Water Research* **47** (2), 463-482.
- Reichel, M. (2015). *Schlammfäulung mit erhöhtem Feststoffgehalt – Chancen, Grenzen, Herausforderungen. (Sludge digestion with high dry solid matter – chances, limits, challenges)*. PhD-Thesis, TU Wien.
- Rosenberger, S., Kubin, K. & Kraume, M. (2002). Rheologie von Belebtschlamm in Membranbelebungsreaktoren (Rheology of waste activated sludge in membrane bioreactors). *Chemie Ingenieur Technik* **74** (4), 487-494.
- Skinner, S.J., Studer, L.J., Dixon, D.R., Hillis, P., Rees, C.A., Wall, R.C., Cavalida, R.G., Usher, S.P., Stickland, A.D., Scales, P.J. (2015). Quantification of wastewater sludge dewatering. *Water Research* **82**, 2-13.
- Slatter, P. T. (1997). The rheological characterisation of sludges. *Water Science Technology* **36** (11), 9-18.
- Slatter, P. T. (2004). The hydraulic transportation of thickened sludges. *Water SA* **30** (5) (Special edition).

©IWA Publishing [2017]. The definitive peer-reviewed and edited version of this article is published in *Water Science & Technology*, Volume 2017, Bonus Issue 1, 276-286, 2017, <https://doi.org/10.2166/wst.2018.111> and is available at www.iwapublishing.com.

This is the accepted version.

Slatter, P. T. (2008). Pipe flow of highly concentrated sludge. *Journal of Environmental Science and Health, Part A: Toxic/Hazardous Substances and Environmental Engineering* **43**, 1516-20.

Swamee, P. K., Aggarwal, N. (2011). Explicit equations for laminar flow of Herschel–Bulkley fluids. *Canadian Journal of Chemical Engineering* **89**, 1426–33.

©IWA Publishing [2017]. The definitive peer-reviewed and edited version of this article is published in *Water Science & Technology*, Volume 2017, Bonus Issue 1, 276-286, 2017, <https://doi.org/10.2166/wst.2018.111> and is available at www.iwapublishing.com.
This is the accepted version.